

B


13° Vaulted Ceiling Throughout

APPROVED FOR PRODUCTION	
Approved By Production	Approved Date
Issued By Sales	Issued Date

LPG INSTALLATION

Room Sealed 33 Condensing Boiler
Room Sealed Fanned Appliance
No Additional Venting
Gas Pipe 22mm - DO NOT REDUCE

Ferrox TF1 Closed Loop Heating System Scale Inhibitor

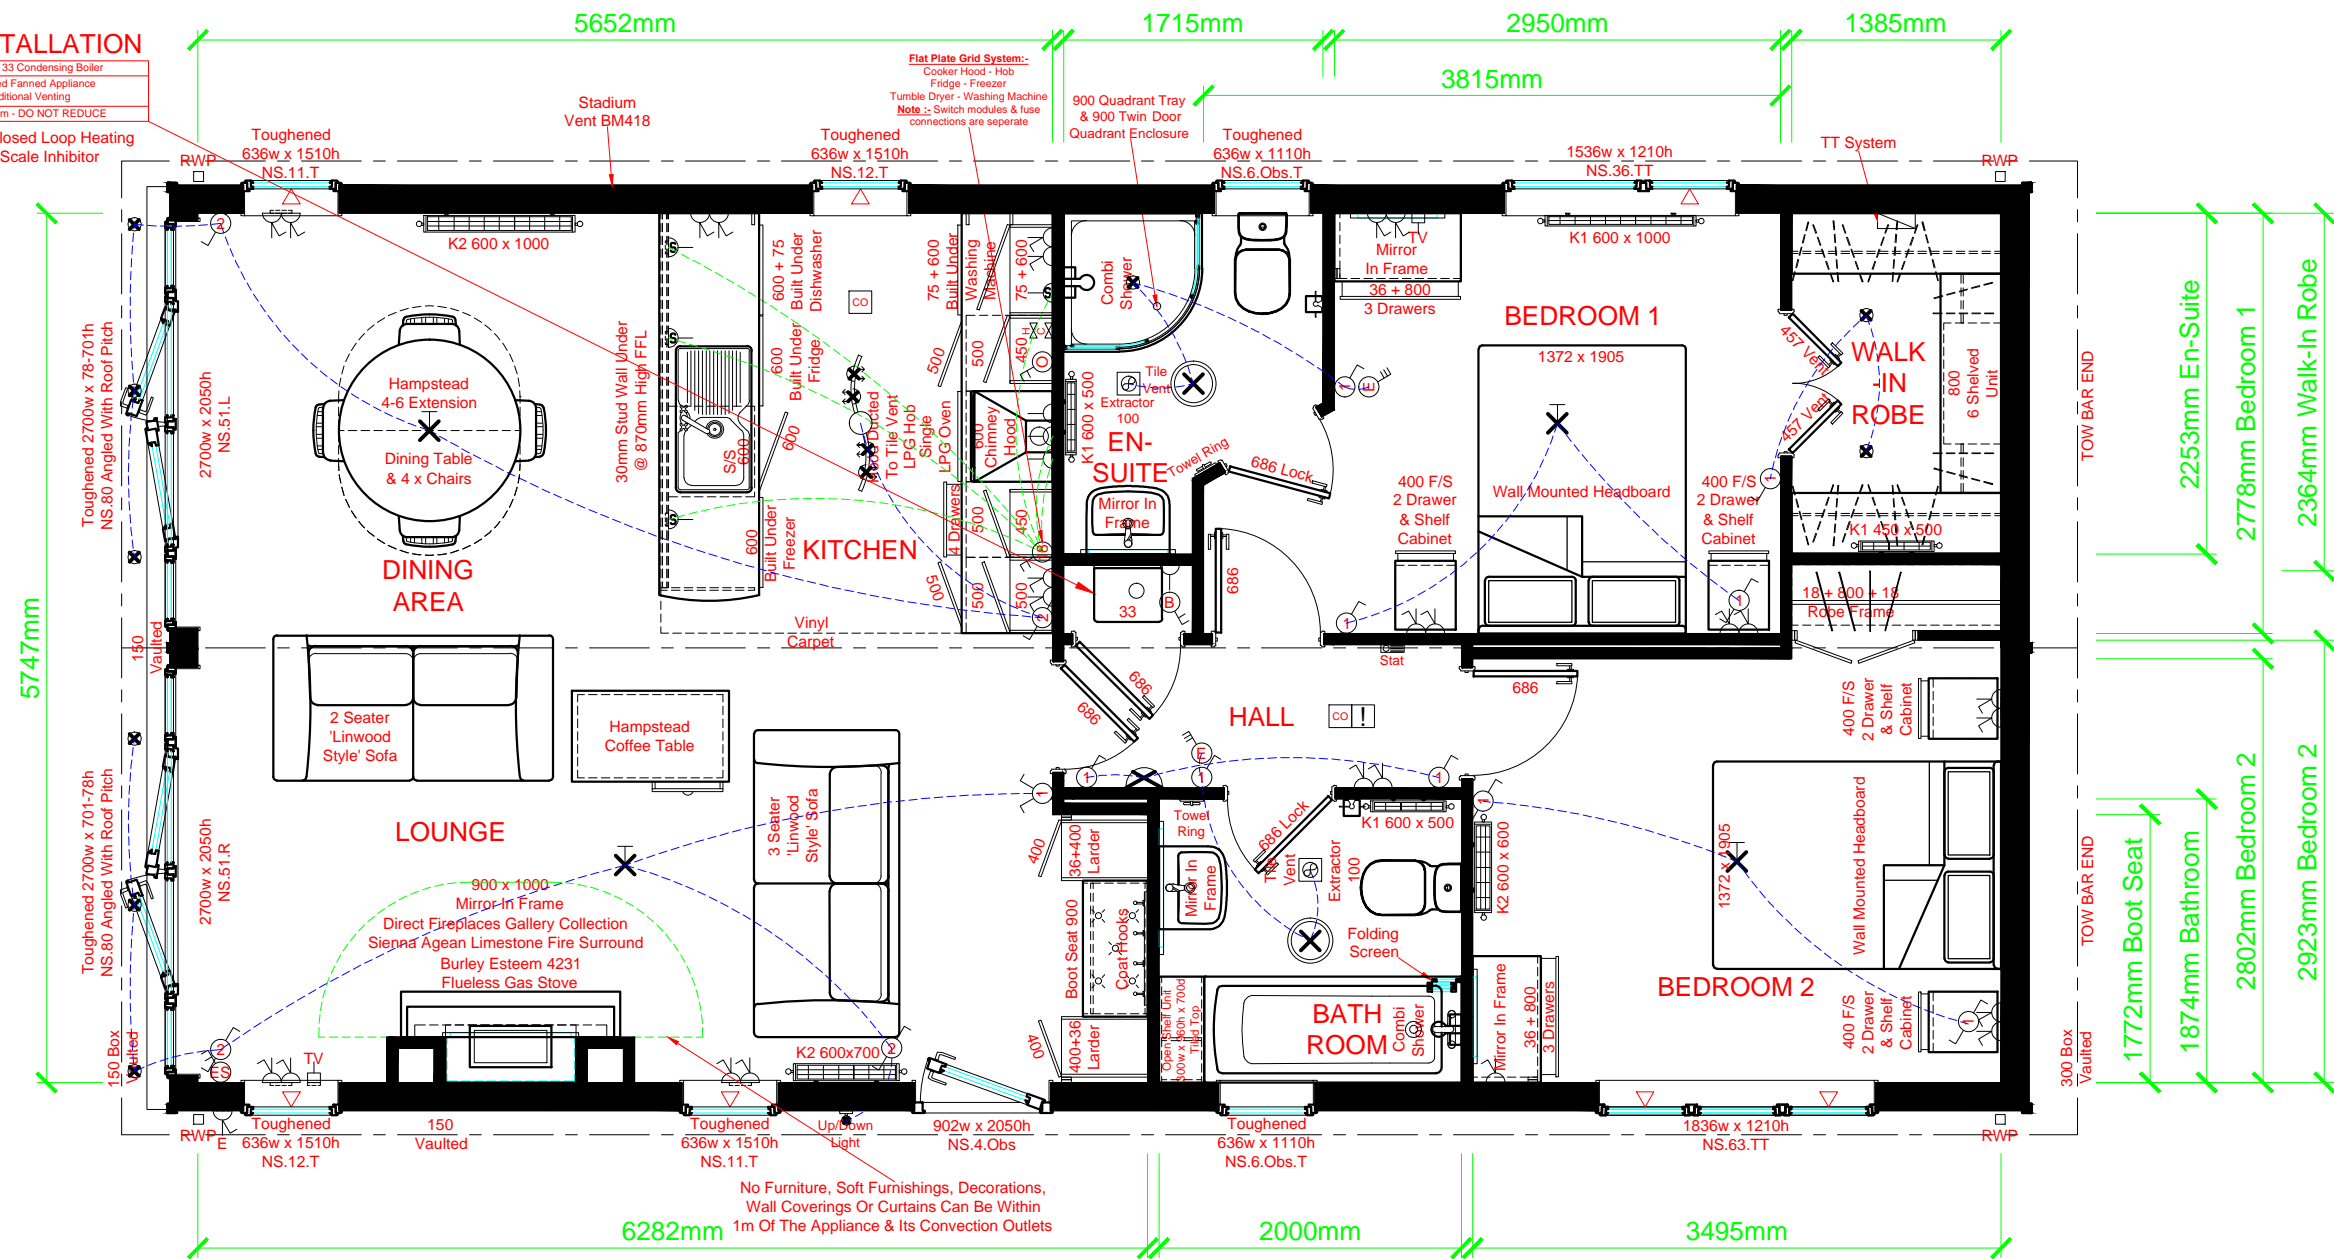

A

C

D



London Road, Brandon, Suffolk. IP27 ONE
Phone: 01842 810673 - Fax: 01842 814328

ROOM VENTILATION CHART Unobstructed Requirements Shown	HIGH LEVEL		LOW LEVEL	
	STADIUM	TRICKLE	RAD SLOT	GRID
LOUNGE or LOUNGE / DINING				
KITCHEN or KITCHEN / DINING				
COMBINED LOUNGE / KITCHEN / DINING		4		
BATHROOM, SHOWER, ENSUITE or WC		1		
ENTRANCE HALL / LOBBY				
BEDROOMS			2	
STUDY				
UTILITY				

Trickle Vent = 4000mm sq.

12.192m x 6.012m (40'-0" x 20')

Westfield 2DB

Tom Hartley Snr - Plot 10A

No:	Revision:	Date:	Date:	21-09-16	14121
A	Production details added. (LJF 14329)	24-09-16	Scale:	1:50	
B	Changes As Per C/O 7149. (AMD 14625)	20-10-16	Drawn By:	BJE	
			Drawing No:	84 16 1017	
			Serial No:	17 OM 84 7050	

This home is designed in accordance with B5.3632